


Из системы отопления Ду 150
(Heating return DN 150)

В систему отопления Ду 150
(Heating supply DN 150)


Из тепловой сети Ду 125
(District heating supply DN 125)

В тепловую сеть Ду 125
(District heating return DN 125)

Estimated weight:			Belongs to:		Alternative materials:	
Supply with certificate						
			Scale	Size	Material	
			7:100	A3	Danfoss Standard	
Mrk.	Approval/Rev	Date			Designation	
Replace					SUB-HS-1250-125-150-C-S	
Design	U257956/20.02.13					
Approval						
Confidential: Property of Danfoss A/S, Nordborg, Denmark. Not to be handed over to, copied or used by third party. Two- or three dimensional reproduction of contents to be authorized by Danfoss A/S.					No. .0	
					General tolerances 1/4	

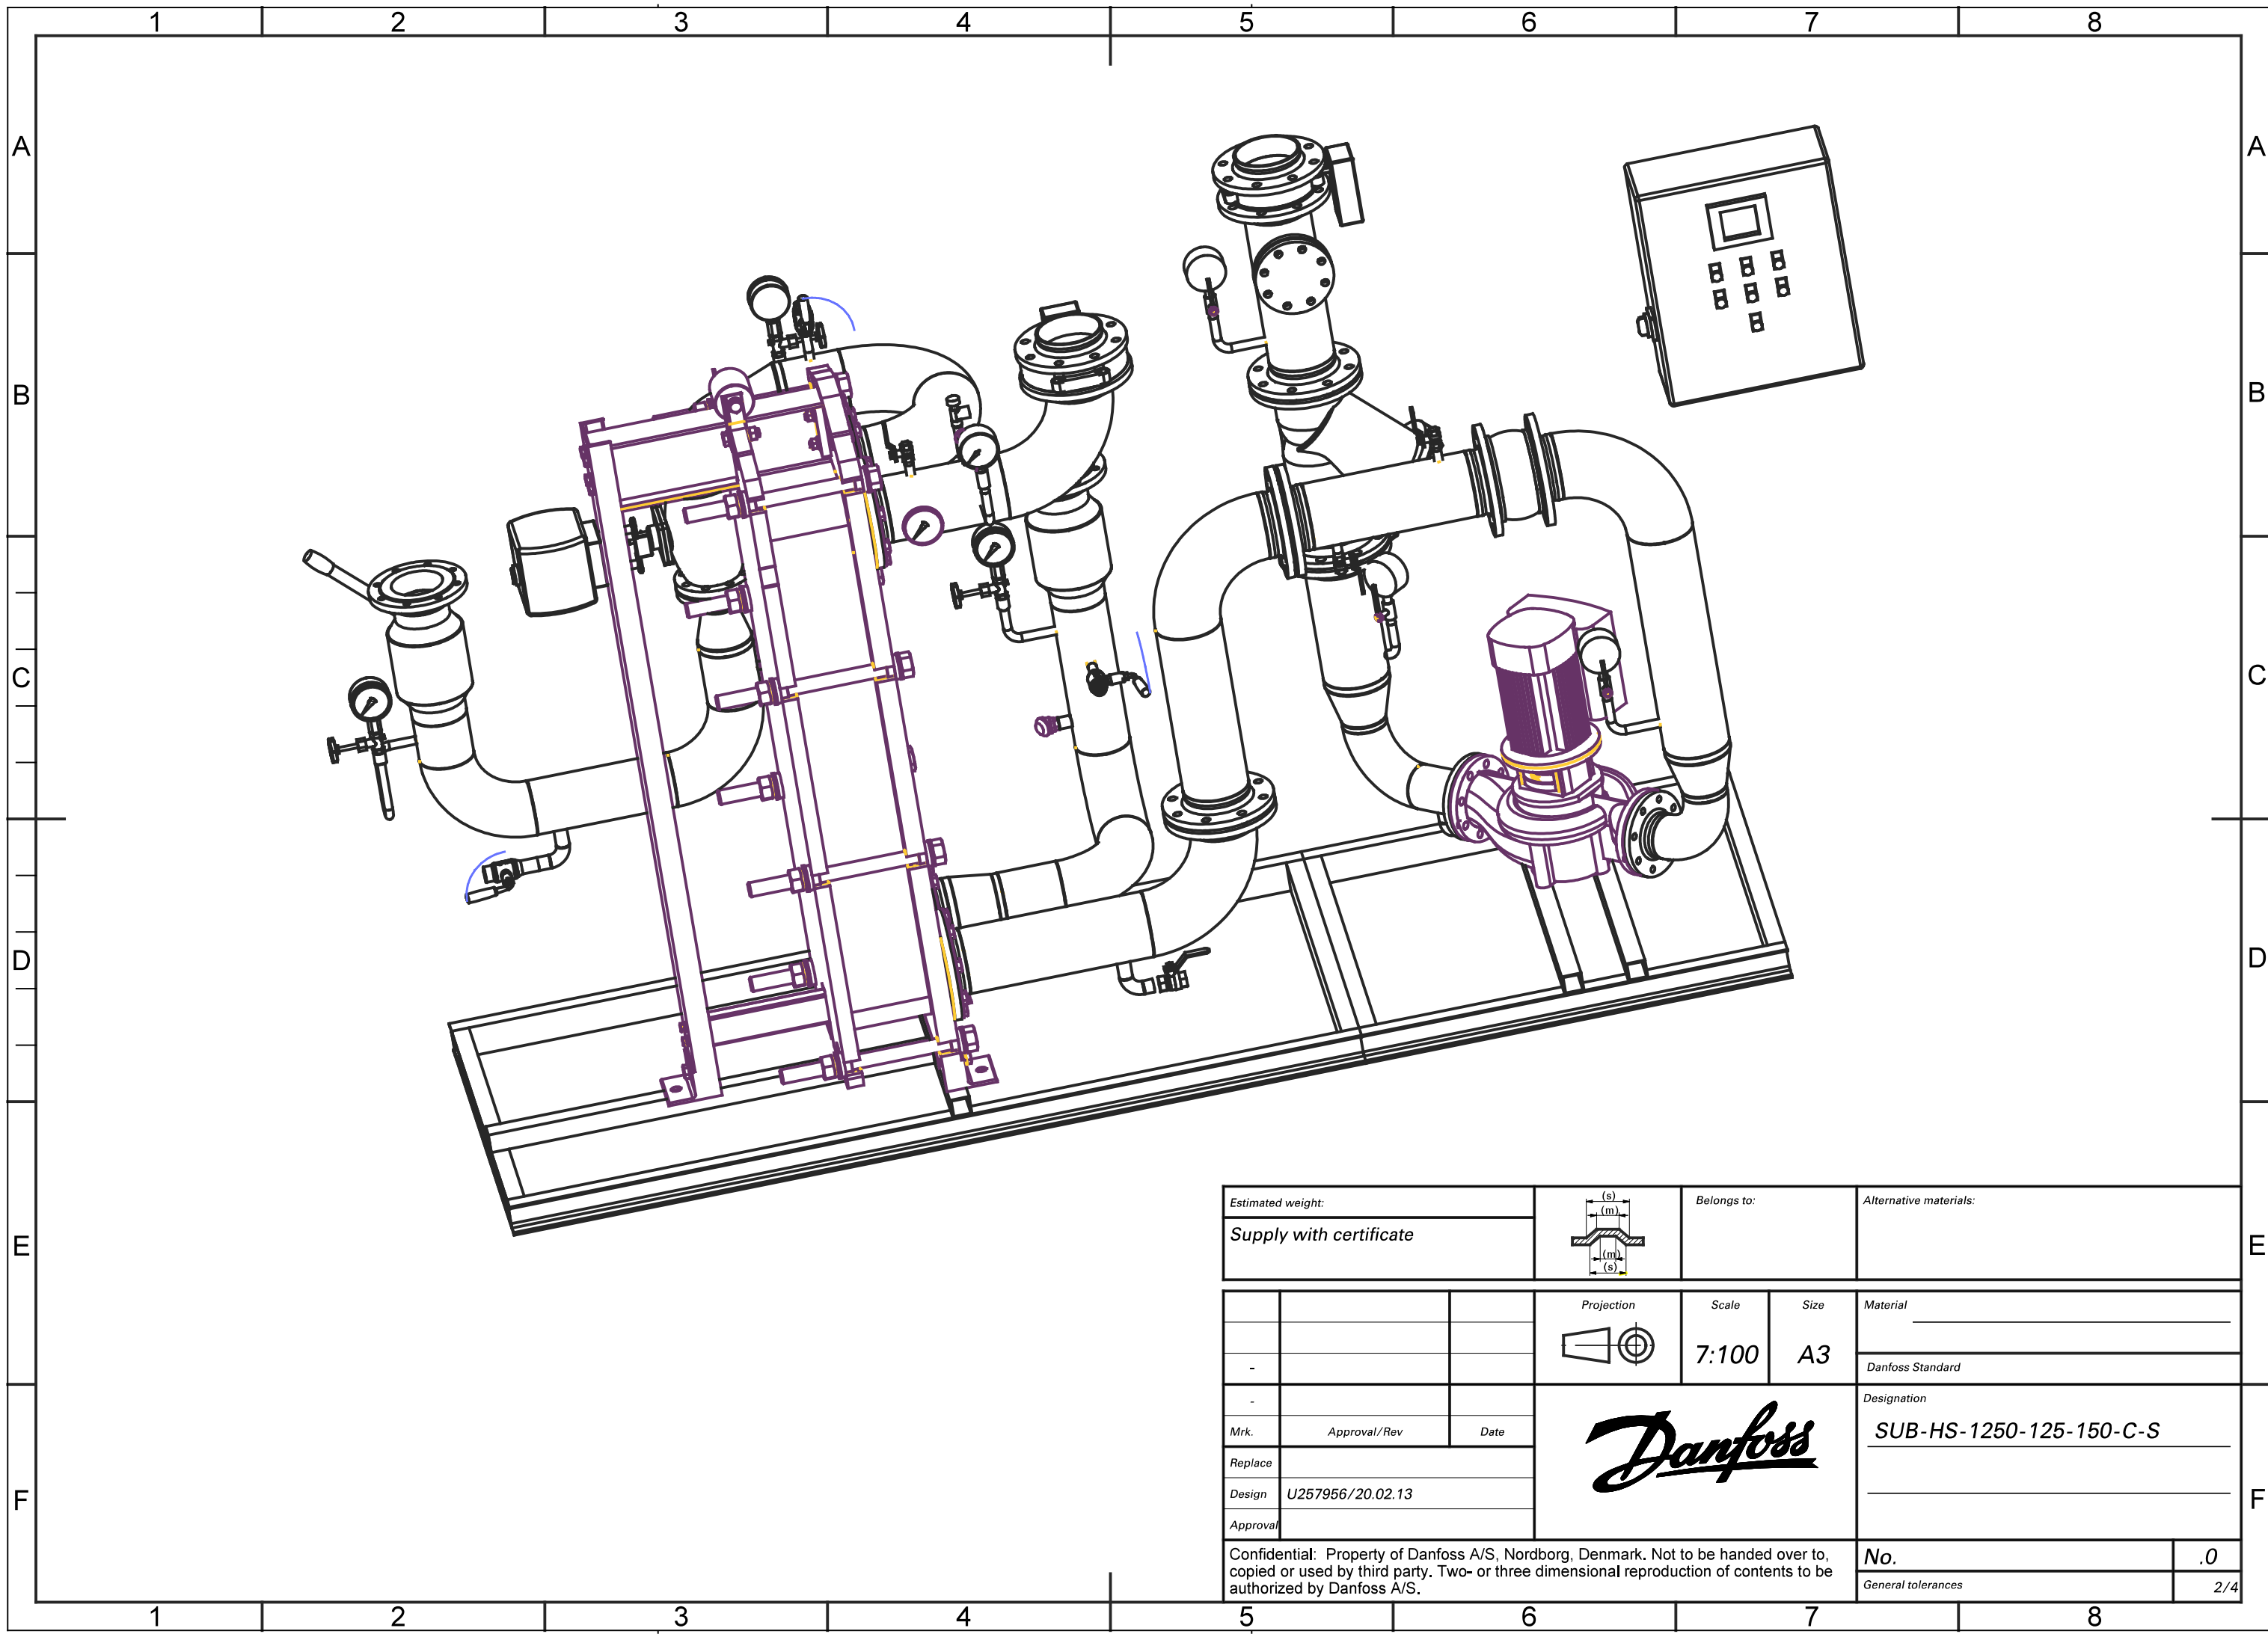

Estimated weight:			Belongs to:		Alternative materials:				
Supply with certificate									
			Scale	Size	Material				
			7:100	A3	Danfoss Standard				
Mrk.		Approval/Rev		Date			Designation		
Replace							SUB-HS-1250-125-150-C-S		
Design		U257956/20.02.13							
Approval									
Confidential: Property of Danfoss A/S, Nordborg, Denmark. Not to be handed over to, copied or used by third party. Two- or three dimensional reproduction of contents to be authorized by Danfoss A/S.							No.		.0
							General tolerances		2/4

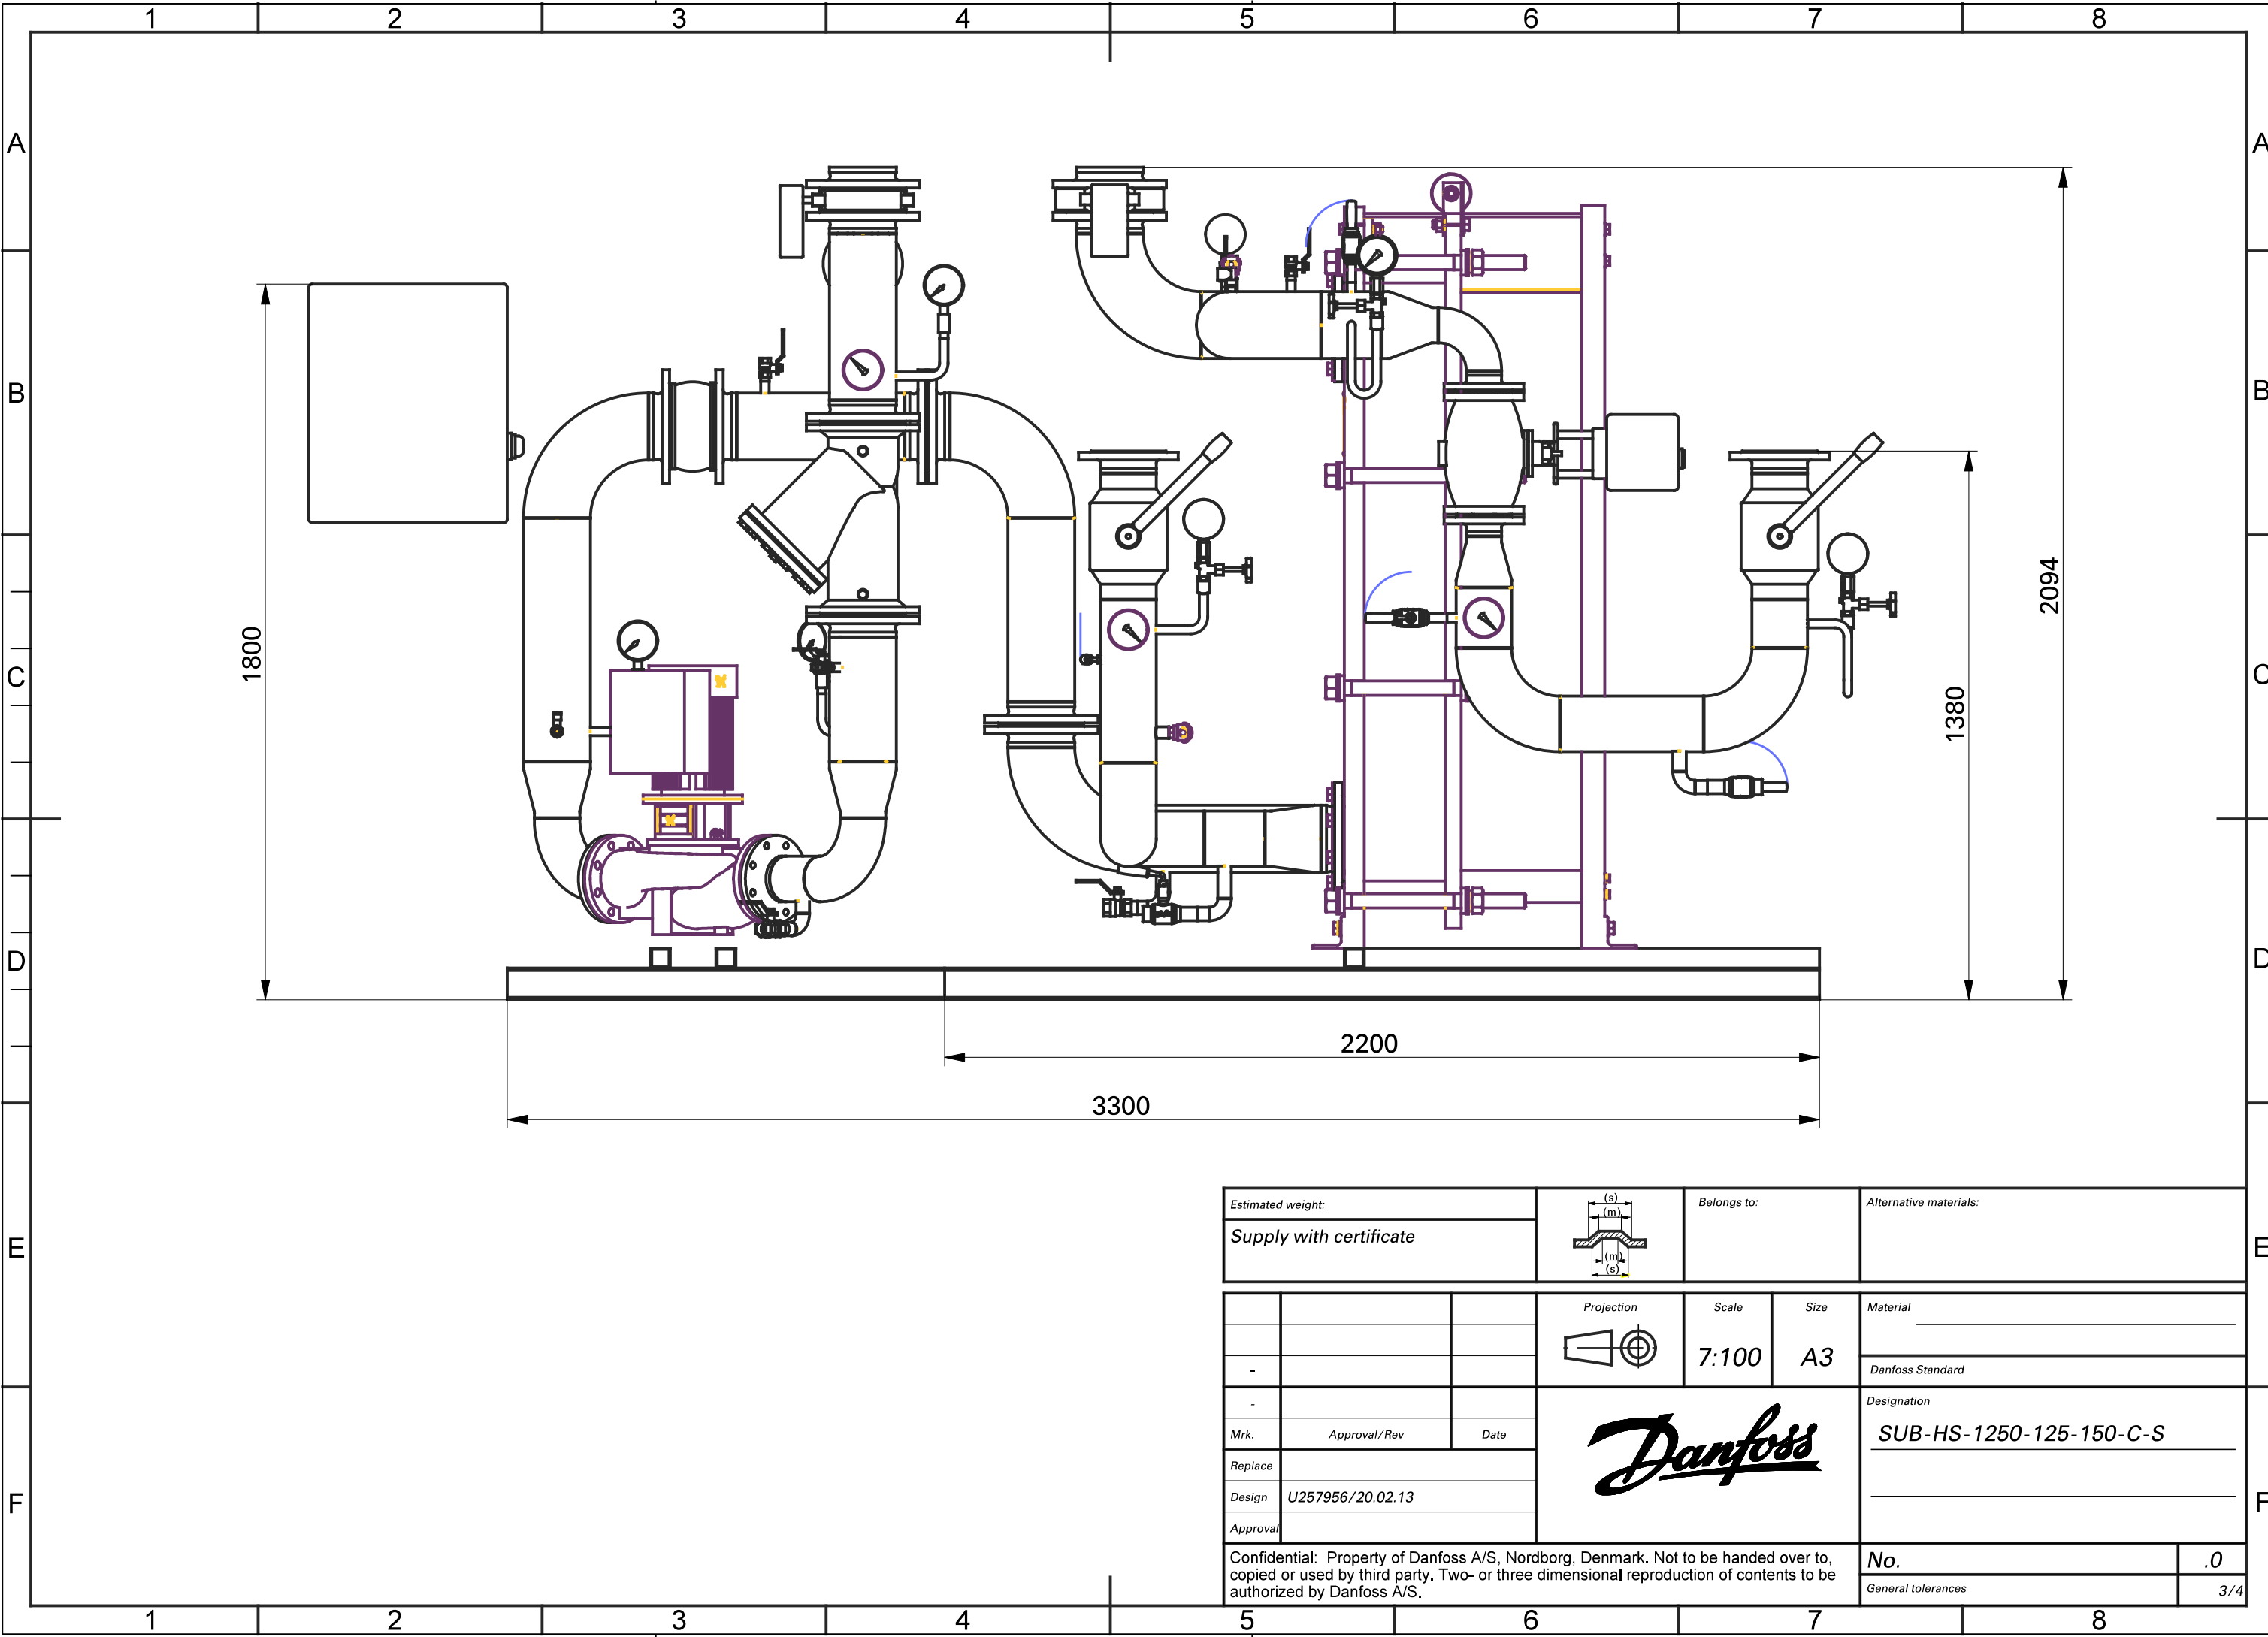

Estimated weight:				Belongs to:	Alternative materials:	
Supply with certificate						
				Scale 7:100	Size A3	Material _____
-						Danfoss Standard
-						Designation
Mrk.	Approval/Rev	Date				SUB-HS-1250-125-150-C-S
Replace						_____
Design	U257956/20.02.13					_____
Approval						
Confidential: Property of Danfoss A/S, Nordborg, Denmark. Not to be handed over to, copied or used by third party. Two- or three dimensional reproduction of contents to be authorized by Danfoss A/S.						No. _____
						General tolerances
						.0
						3/4

